
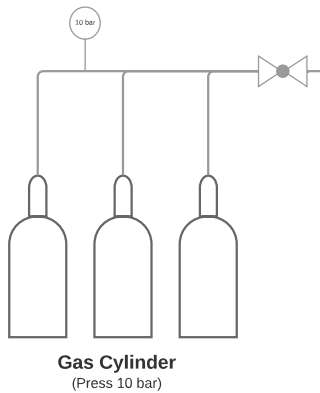


P&ID OF MODULATING GAS SYSTEM (0-10 VDC)

Satit Pumpruk | September 19, 2019

Document : PP-PID04-1-1 | Customer : VRH

Project : J190919 | Revision : 00

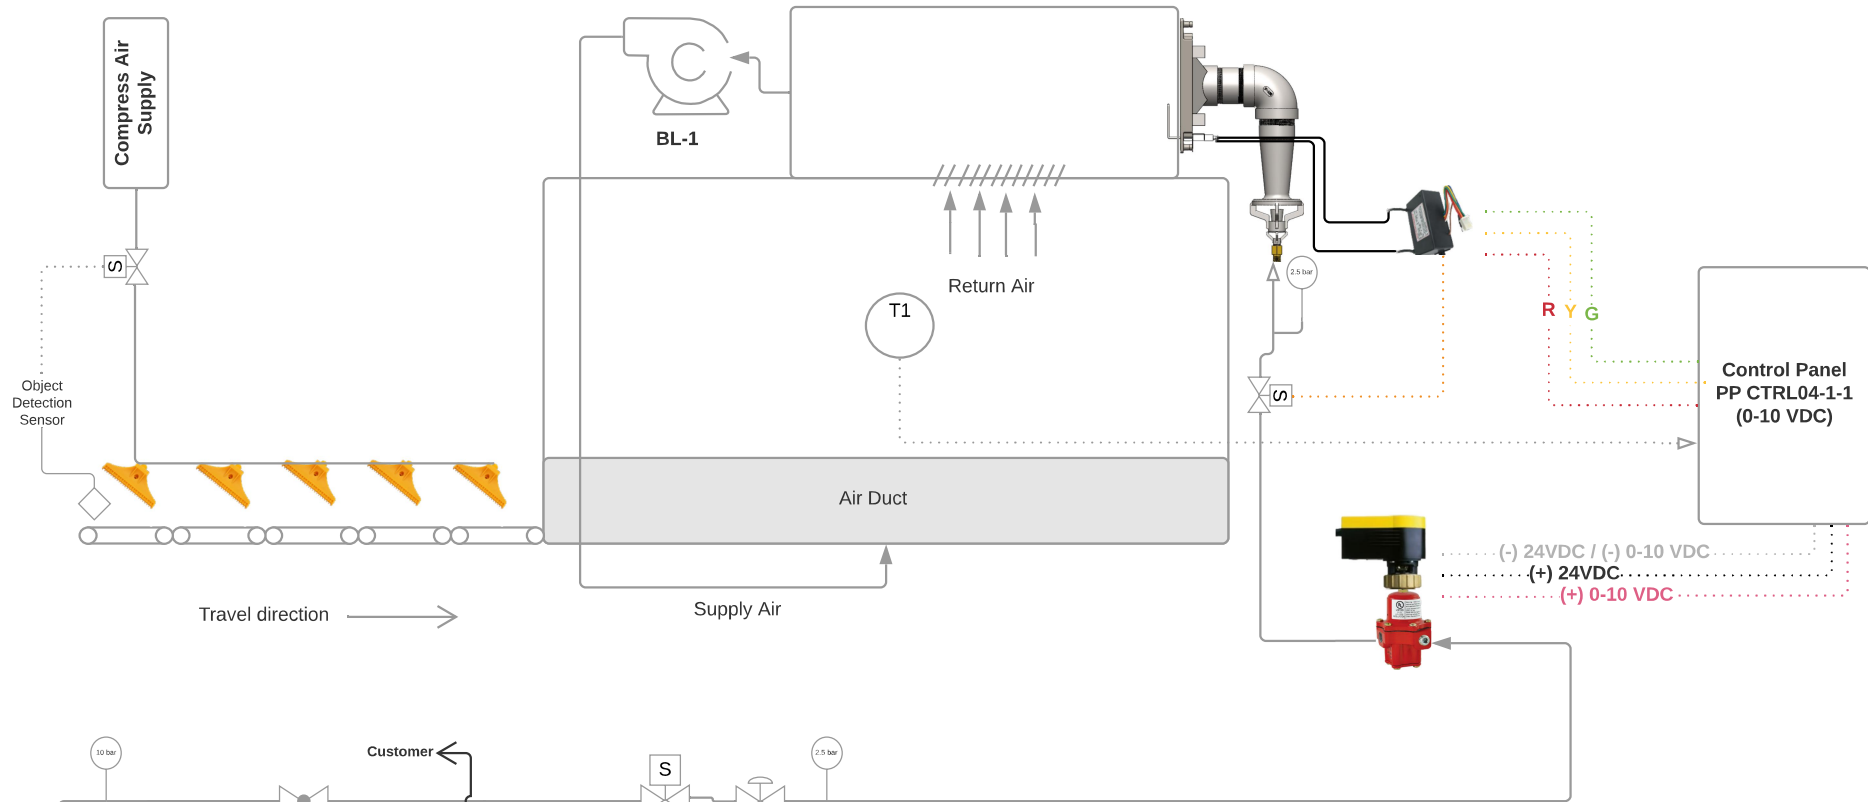

Zone no.	Zone name	Temperature	Distance	Design speed	Time
1	Air Blow	-	2 m	1 m/min	2 mins
2	Heating	80C	4 m	1 m/min	4 mins

Product size	Require capacity	Conveyor width	Qty / width	Calculated capacity
L1,000mm x H180mm	200 pcs / hr	0.8 m	4	240 pcs / hr

Symbol	
Pipe line	—————
Electric wire